


Ma That Nwe (TGY B...
last seen recently

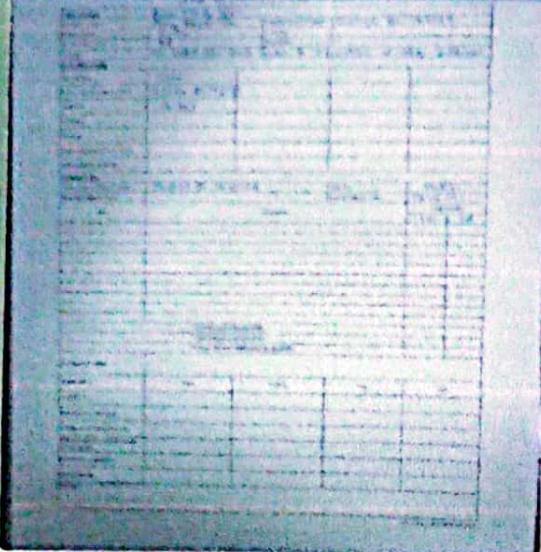


အစ်မရှင် ဒါကလေး 510.24 မှ 17.10.24 ထိ
အစ်မတို့ဆီမှာ Yangon HO RE Service
မှ PIC Kyaw Naing Soe, Aung Phyo
Thu တို့နှစ်ယောက်သည် U San Myint
6kW solar system installation, MNG
battery inspection, TGY Myoma Tower
inspection, Aungpan CW's House
inspection, Shwe Nyaung Golden Gate
inspection တို့ အတွက် TA form မှာ အစ်မ
ဆီမှ approve လေးလို့ချင်လို့ပါရှင်အစ်မ။
11:20 AM ✓

Ei Thwe Phyo
အစ်မရှင်။ 25.9.24 မှ 4.10.24 ထိ အစ်မတို့...
Ok Approved
11:20 AM

Ei Thwe Phyo
အစ်မရှင် ဒါကလေး 510.24 မှ 17.10.24 ထိ...

Message

3:38 PM
Ma May Thin Chel
last seen at 3:27 PM

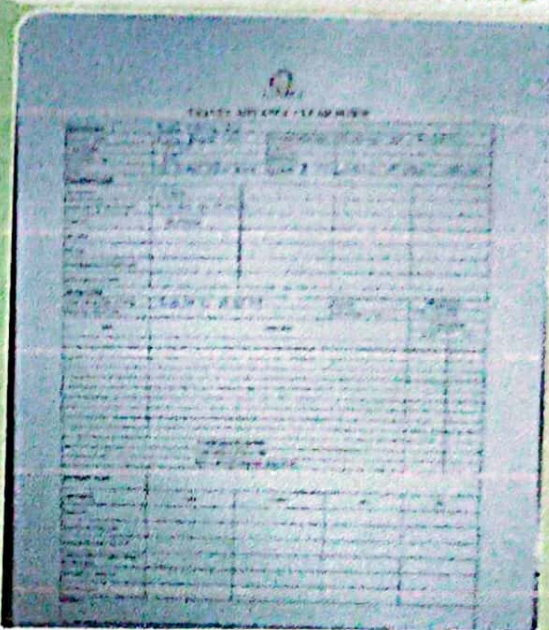

အစ်မရှင် ဒါကလေး 510.24 မှ 17.10.24 ထိ
အစ်မတို့ဆီမှာ Yangon HO RE Service
မှ PIC Kyaw Naing Soe, Aung Phyo
Thu တို့နှစ်ယောက်သည် U San Myint
6kW solar system installation, MNG
battery inspection, TGY Myoma Tower
inspection, Aungpan CW's House
inspection, Shwe Nyaung Golden Gate
inspection တို့ အတွက် TA form မှာ အစ်မ
ဆီမှ approve လေးလို့ချင်လို့ပါရှင်အစ်မ။
11:15 AM ✓

Confirm pr
11:25 AM

ကျေးဇူးတင်ပါတယ်ရှင် အစ်မ။
11:31 AM ✓

Message

ရွှေတံခါး

ပင်လယ်ကမ်းခြေရပ်ကွက် အမှတ် (၂)
ကော့စတေးလ်

Ph : 081-45376 , 09-8350428

Octane(92)

VINo: C2 11

Date: 07-Oct-2024 10:17 1

Pump: 0 3

လက်ခံ

ဆိုင်ကတ်

Gal Liter Price

Total

0.475 2.160 3240

7000

ပျော် - မုန့်စားကပ် ကံကပ်

ပင်လယ်ကမ်းခြေရပ်ကွက် အမှတ် (၂) ကော့စတေးလ်

Thank You Please come again

ကုမ္ပဏီ - U San Myint



ရွှေတံခါး

Shwe Dagar (taung lay lone)

(Taung Lay Lone) 081-45376, 09-5566644, 09-896000822

Octane 92 RON

Vr No: H 01 2041016 0522

Date: 10/10/2024 10:20:12 AM

Pump: Pump 4 Car No: Cycle

Cashier: Pcs Day Co., Ltd

Gal	Liter	Price	Amount
0.359	1.634	3060	5000

Thank You Please come again

you - U San Myint

ရွှေတံခါး

တော်လှန်ရေးအဖွဲ့အစည်းတိုင်း အဖွဲ့ဝင် (၂)

အောင်မြင်စွာ

Ph : 081-45376 , 09-8350428

Octane(92)

VtNo: C2 18

Date: 12-Oct-2024 09:34:5

Pump: O 3

လက်

ဆိုင်ကပ်

Gal Liter Price

Total

0.359 1.634 3060

5000

အဖွဲ့ဝင်များအတွက်

အဖွဲ့ဝင်များအတွက် အဖွဲ့ဝင်များအတွက် အဖွဲ့ဝင်များအတွက်

Thank You Please come again!

Maajestic Hotel



Maajestic

Shwe Dagar (taung lay lone)

(Taung Lay Lone) 081-45376, 09-5566644, 09-896000822

Octane 92 RON

Vr No: 1101 20241014 0408









Date: 14/10/2024 9:39:58 AM

Pump: Pump 2 Car No: Cycle

Cashier: Pos Day GG2

Gal	Liter	Price	Amount
0.343	1.560	3205	5,000

Thank You Please come again!

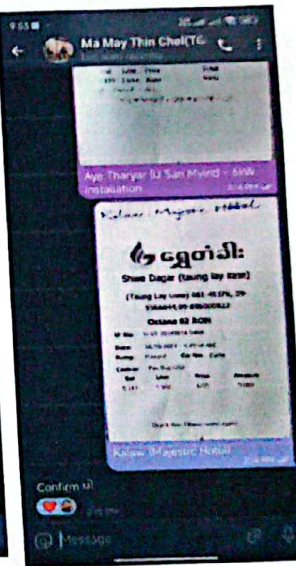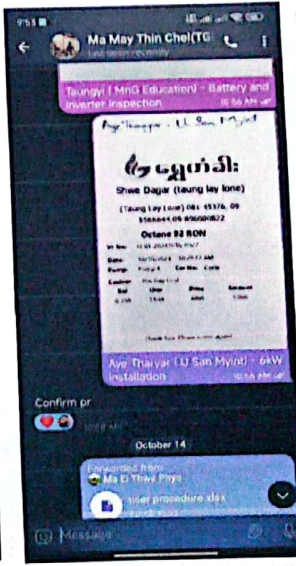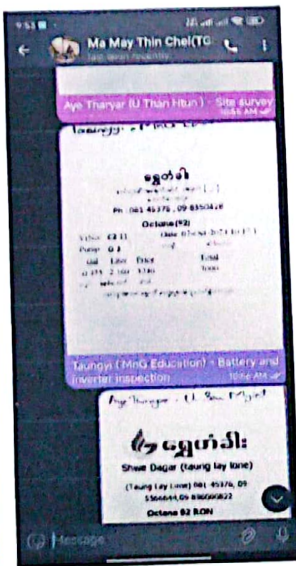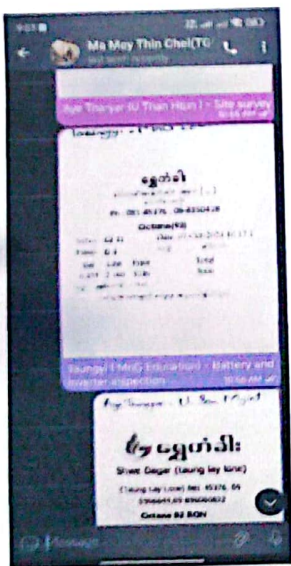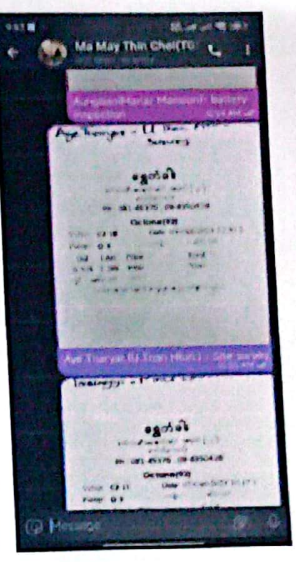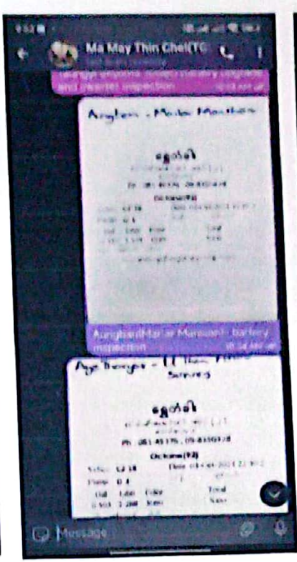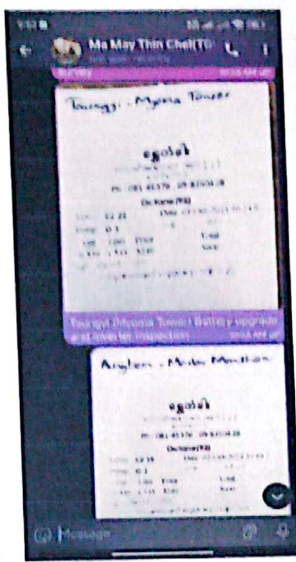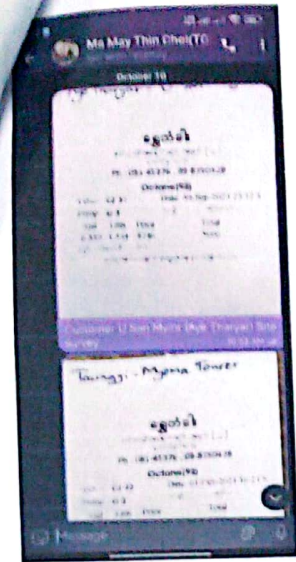

No	Date	Holding Business	Department	Name	Rental Purpose	Departure Time	Start Location	End Location	Claim Amount	Allowed Amount	Status	Remark
14	2024-10-16	Renewable Energy	Service	Nay Win Myint(2)	Inspection (Change new ATS)	17:45	Mingyati Bus stop(Insein)	Ywama(Bayint naung road)	12,000	12,000	GA Manager Approved	Holiday (Urgent customer call)
15	2024-10-17	Renewable Energy	Service	Aung Phyoe Thu (2) , Kyaw Naing Soe	Installation of 6kW solar system & other inspecton	06:00	Aung mingalar highway	Bogyoke	22,000	22,000	GA Manager Approved	Lots of tools & package.
16	2024-09-25	Renewable Energy	Service	Aung Phyoe Thu (2) , Kyaw Naing Soe	Installation 10kW all in one set in Majestic Hotel & Inspection of other customer	06:30	Bogyoke	Aung Mingalar Highway	22,700	22,700	GA Manager Approved	lot of tools and package
17	2024-10-13	Renewable Energy	Service	Nay Win Myint(2)	Inspection of ATS (Show how to use ATS)	11:25	Ywama(Bayintnaubg)	Mindhama (CW's House)	7,600	7,600	GA Manager Approved	Sunday (Urgent)
18	2024-10-13	Renewable Energy	Service	Nay Win Myint(2)	Inspection of ATS (Show how to use ATS)	12:45	Mindhama (CW's House)	Ywama(Bayintnaubg)	7,600	7,600	GA Manager Approved	Sunday (Urgent)

Requisition Date 10/21/2024
 Requisition Name Ei Thwe Phyo
 Holding Business Renewable Energy
 Department Service
 HR Acknowledge Nyein Ei Ei Khaing
 Total Charges 22,000.00

Taxi Claim Charges Details


#	Date	Employee N...	Departure Ti...	Start Locatio...	End Locatio...	Claim Amou...	Allowed Am...	GA Feedback...	Rental Purp...	Remark
1	10/17/2024	Aung Phyo... Kyaw Nain...	06:00	Aung mingalar highway	Bogyoke	22,000.00	22,000.00		Installation of 6kW solar system & other inspecton	Lots of tools & package.

Add a line


Send message Log note Schedule activity


0 Following 1


October 22, 2024


Maung Maung Htwe(2) - now
 • State: Related HR → GA(GM/AGM)

October 21, 2024


Phyo Thu - now
 • State: Related Manager → Related HR


Phyo Thu - now
 • State: Submit → Related Manager


Zin Zin Oo - now
 • State: Draft → Submit


Zin Zin Oo - now
 Taxi Chrages Claim Form created



TRAVELLING REPORT

Date: 21.10.24

Report To	Aung Ro Ko Oo	
Employee Name	Myaw Nwng 3re, Aung Phye Sbu	
Position	STDP	STDP
Department	Service	
Business	RE	
Departure & Arrival	Departure Date And Time	Arrival Date And Time
	5-10-24	13-10-24
Total Days	13day	
Trip Information	1. From	To
	2. From	To
	3. From	To
Purpose For Travelling	To install & San Myad & Inspection of T&Y	
Travel Date	Activities	Remark
	The daily report attached by below.	

Reported by
 Sign :
 Name : Myaw Nwng 3re
 Position : STDP-1

Checked by
 Sign :
 Name : Aung Ro Ko Oo
 Position : ADH

Approved by
 Sign :
 Name : U Aye Man Htoon
 Position :

(DH/AGM/GM)

(COO)

05-CHL-HRM-FRM-064-01

No.	Date	Status	Job Types/Number
1	5.10.24	Attend	Do the SS at TGY branch. Went to U San Myint (Aye Tharyar) to discuss location of Inverter and battery.
2	6.10.24	Holiday	Buy the needed accessories for customer U San Myint (Aye Tharyar) 6kW installation.
3	7.10.24	Attend	Went to MNG education (Taunggyi) to check battery inspection. Checked the ML 200Ah battery without display version and firmware upgraded it to version 3.05C (Red Light). And checked out the connection cables loose or not. Retight the screws and made clean the inverter , battery and AC / Dc DB boxes. Then open the system back and charge up the battery with only solar. It's ok. Also Customer load consumption is ok. Therefore suggested the customer to use the solar when the battery percent is full of 100%.
4	8.10.24	Attend	Did the morning exercise and joined the daily meeting. Went to Taunggyi MyoMa Tower to connect online monitoring wifi system. It's ok. And explained how to look up the usage about it.
5	9.10.24	Attend	Went to Kanthar Heho specialist clinic (Heho Tsp) and Oil Factory for sale marketing. And checked up the arrival ML 550W solar 1 pallet , ML 6KW off-grid inverter 1 unit and accessories box 1 pcs for the site.
6	10.10.24	Attend	Did morning exercise and made cleaning the show room. Send the solar equipments to Ayetharyar customer U San Myint for solar installation. Then started to set up 6KW off-grid inverter and made AC / DC wiring installation. Set up cable-lug battery cable. Did morning exercise and made cleaning the show room. Send the solar equipments to Ayetharyar customer U San Myint for solar installation. Then started to set up 6KW off-grid inverter and made AC / DC wiring installation. Set up cable-lug battery cable.
7	11.10.24	Attend	Did the morning Exercise and made cleaning the show room. And Went to Aye Thar Yar customer U San Myint (MRC) site , set up Rail Rods and installed 8pcs of ML 550W solar panels. Then run the solar cable with the pipe along to DC panel box. And made earthing system.
8	12.10.24	Attend	Went to Aye Thar Yar customer U San Myint (MRC) site , set up AC / DC input output wiring connection and also installed earthing wiring system. Then set up the battery and connected the solar MC4 connectors. And checked the connection cables and made tight the breaker necks. Test with the solar and Epc for charging to the battery. It's ok. But we'll test full loads at the tomorrow because it's so cloudy in evening.
9	13.10.24	Holiday	At Aye Thar Yar customer U San Myint (MRC) site , test run full loads with solar , Epc and battery. It was ok. Explained to the customer how to use about the system and if something goes wrong , suggested do the system on/off functions as the instructions.

10	14.10.24	Attend	Did the morning exercise and made cleaning the show room. Joined the daily sale meeting. Went to Kalaw Majestic Hotel for inspections. There was changed main AC breaker and AC cable size by electrician. So that we changed the inverter's battery charging ampere from 50A to 80A. And we test charging the battery with Epc. It was ok. Also Load consumptions are ok.
11	15.10.24	Attend	Customer U San Myint (Aye Tharyar) went to check the solar power supply. No power because the solar fuse is broken. Went to Aungban and bought a Solar Fuse. - Came back and replaced the new solar fuse and it worked fine.
12	16.10.24	Holiday	Check and keep material and tools list. Packaged the package.
13	17.10.24	Holiday	Come back Yangon HO from TGY.