



GENERAL EXPENSE CLAIM FORM



BU/BR/DIV Name : PG BU
 Department Name : Marketing & Sale Support

No.	Date	PIC Name	Description	Category (Customer (Or) Operation)	Cost (MMK)	Remark
10	16.1.25	Ahet Thu Zay	Name Plate 5 pcs making ① NP-2758, 2308082 (2pcs) For T-Domuts	Operation	30000	
			② MC-165A8, 150KVA A 2311439, A 2311440 & A 2311441, 3pcs		45000	
Total General Expense					75000/-	

Requested by: Sign:
 Name: Ahet Thu Zay (Requester)


Approved by: Sign:
 Name: Department Head (Department Head)

Checked by: Sign:
 Name: Luim² Aung (Finance & Account)

Approved by: Sign:
 Name: Sae Hked (OM/AGM/GM)

Approved by: Sign:
 Name: Ko Zaw Min (ACOO/COO/MD/VCM)

02-PWG-FNA-FRM-001-00



DIESEL GENERATING SET

GB /T2820 eqv ISO8528

Model MC-165AS

S/N A2311440

Date 2023/05

PRIME 150 KVA 120 KW
STANDBY 165 KVA 132 KW

CURRENT 238 A

VOLTAGE 400/230 V

FREQUENCY 50 Hz / 1500 rpm

cos ϕ 0.8

Dimension 3600 x 1165 x 1950 MM

WEIGHT 2041 KG

Matador Power Generator
Manufactured by UMG Matador

DIESEL GENERATING SET

GB /T2820 eqv ISO8528

Model MC-165AS

S/N A2311439

Date 2023/05

PRIME 150 KVA 120 KW
STANDBY 165 KVA 132 KW

CURRENT 238 A

VOLTAGE 400/230 V

FREQUENCY 50 Hz / 1500 rpm

cos ϕ 0.8

Dimension 3600 x 1165 x 1950 MM

WEIGHT 2041 KG

Matador Power Generator
Manufactured by UMG Matador

DIESEL GENERATING SET

GB /T2820 eqv ISO8528

Model MC-165AS

S/N A2311441

Date 2023/05

PRIME 150 KVA 120 KW
STANDBY 165 KVA 132 KW

CURRENT 238 A

VOLTAGE 400/230 V

FREQUENCY 50 Hz / 1500 rpm

cos ϕ 0.8

Dimension 3600 x 1165 x 1950 MM

WEIGHT 2041 KG

Matador Power Generator
Manufactured by UMG Matador

MATADOR DIESEL GENERATING SET

Compliance: ISO 8528

MODEL VP - 275S Perf.class G-2 Phase 3
Serial No. 2308082 Speed 1500 r/min Altitude 1000 m
Prime Power(PRP) 250 KVA 200 KW
Standby Power(LTP) 275 KVA 220 KW
Voltage 400 V Frequency 50 Hz
Power Factor cos ϕ = 0.8 Current 361 A
Ambient Temperature 50 °C Weight 2870 kg
Dimension 3590 x 1310 x 2050 mm Date 2023 . 08

Power By Volvo Penta

MATADOR DIESEL GENERATING SET

Compliance: ISO 8528

MODEL VP - 275S Perf.class G-2 Phase 3
Serial No. 2308082 Speed 1500 r/min Altitude 1000 m
Prime Power(PRP) 250 KVA 200 KW
Standby Power(LTP) 275 KVA 220 KW
Voltage 400 V Frequency 50 Hz
Power Factor cos ϕ = 0.8 Current 361 A
Ambient Temperature 50 °C Weight 2870 kg
Dimension 3590 x 1310 x 2050 mm Date 2023 . 08

Power By Volvo Penta



CASH RECEIPT

To : Winning Way

Date 17.1.2025

Attn :

.....

Sr.	Description	Quantity	Unit Price	Total Price
	ကျွန်းစားစာပိတ်စာ	1		35000
	Soundroof Stickers	2		5000
				7
	Total			
	Advance			
	Balance			

na

 (Signature)

1570

New Making Sticker

SOUNDPROOF

SOUNDPROOF

Damage stickers



New Making stickers





Damage Shield



ဝက်မမောင်းခင်စစ်ဆေးရန် လိုအပ်သော အချက်များ

- ၀၁။ အင်ဂျင်စီပိုင်ရှင်စစ်ဆေးပါ။
- ၂။ ဝက်မမောင်းပီစီစီတိုင်ကီထဲတွင် ဝေရီဖိုင်နီမရှိစစ်ဆေးပါ။
- ၃။ ပန်ကာကြိုး၊ တင်းအားကိုစစ်ဆေးပါ။ အင်ဂျင်စီပန်ကာကြိုး အခြေအနေကိုစစ်ဆေးပါ။
- ၄။ ဝက်ဖ်လေစစ်တိုင်းတာမှု အချက်ပြကိရိယာကိုစစ်ဆေးပါ။
- ၅။ ဝေလစစ်ကို သန့်ရှင်းပေးရန် လိုအပ်ပါက သန့်ရှင်းပေးပါ။
- ၆။ ဆီတိုင်ကီထဲတွင် ဆီလုံလောက်စွာ ရှိမရှိ စစ်ဆေးပေးပါ။
- ၇။ ဘက်ထရီအက်စစ်အမှတ်ကိုစစ်ဆေးပါ။ အကယ်၍ မပြည့်ပါက ချိုးဖျက်ခြင်းပေးပါ။
- ၀၈။ ဘက်ထရီပတ်များကို ချောင်းချောင်းသံချေးတက်မတက်စစ်ဆေးပါ။
- ၀၉။ ဘက်ထရီအားသွင်းစက်တပ်ဆင်ထားပါက စစ်ဆေးပါ။
- ၀၀။ ဝက်ဖ်အပိုင်းအား လုံ့လီများ၊ တိုင်များ၊ ချောင်းချောင်း ဝေလျာ နဲ့ မှုန်မရှိစစ်ဆေးပါ။
- ၀၀၁။ ဝေလျာကြိုးများ၊ လျှပ်စစ်လိုင်းများ အားလုံးကို စစ်ဆေးပါ။
- ၀၀၂။ ဝက်ကို တပတ်လှည့်လည် စစ်ဆေးပေးပါ။
- ၀၀၃။ ဝက်ဖ်ဆီ၊ ဝေလျာဆီ၊ ဝေလျာစက်သုံး၊ မောင်းဆီ ယိုစိမ့်မှု ရှိမရှိ စစ်ဆေးပေးပါ။
- ၀၀၄။ ဝက်ဖ်အသုံးပြုနှုန်းကို စစ်ဆေးပေးပါ။
- ၀၀၅။ နာရီ(၂၅၀) တစ်ကြိမ် အင်ဂျင် service လုပ်ပေးပါ။ (သို့မဟုတ်) သက်ဆိုင်ရာ ဌာနသို့ အကြောင်းကြားပေးပါ။

Hot Line - 09 977 835 262, 09 977 835 457

GENERAL EXPENSE CLAIM FORM

BU/BR/DIV Name :

PG BU

Department Name :

Marketing & Sale Support

No.	Date	PIC Name	Description	Category (Customer (Or) Operation)	Cost (MMK)	Remark
1.	21.1.25	Htet Thee Zay	HO Stock Machine MW - 165PS			
			① 2404136072F	Operation	30000	
			② 2404136062F			
			150 KVA x 2 units			
			Modify making			
			Name Plate			
Total General Expense					30000	

Requested by

Sign :

Name :

Htet Thee Zay

(Requester)

Approved by

Sign :

Name :

My U Ky

(Department Head)

Checked by

Sign :

Lwin Aung

(Finance & Account)

Approved by

Sign :

Sae Htet Pin

(OM/AGM/GM)

Approved by

Sign :

Ko Zaw Min Mye

(ACOO/COO/MD/VCM)

02-PWG-FNA-FRM-001-00

MATADOR DIESEL GENERATING SET

Model	MW-165PS	Perf.class	G2	Phase	3
Serial No.	2404136072F	Speed	1500rpm	Altitude	1000 m
Prime Power	150	kVA		120	kW
Standby Power	135	kVA		132	kW
Voltage	400	V	Frequency	50	Hz
Power Factor	COS Φ =0.8		Current	216.5	A
Ambient Temp:	40°	C	Weight	2070	kg
Dimension	3200x1100x1850		mm	Date	2024.04

Made by Welchai Assembled in Weifang, Shandong, China

MATADOR DIESEL GENERATING SET



Model	MW-165PS	Perf.class	G2	Phase	3
Serial No.	2404136062F	Speed	1500rpm	Altitude	1000 m
Prime Power	150	kVA		120	kW
Standby Power	135	kVA		132	kW
Voltage	400	V	Frequency	50	Hz
Power Factor	COS Φ =0.8		Current	216.5	A
Ambient Temp:	40°	C	Weight	2070	kg
Dimension	3200x1100x1850		mm	Date	2024.04

Made by Welchai Assembled in Weifang, Shandong, China

< Back

PG Unit Sale Team & SRV Team

20 members, 4 online

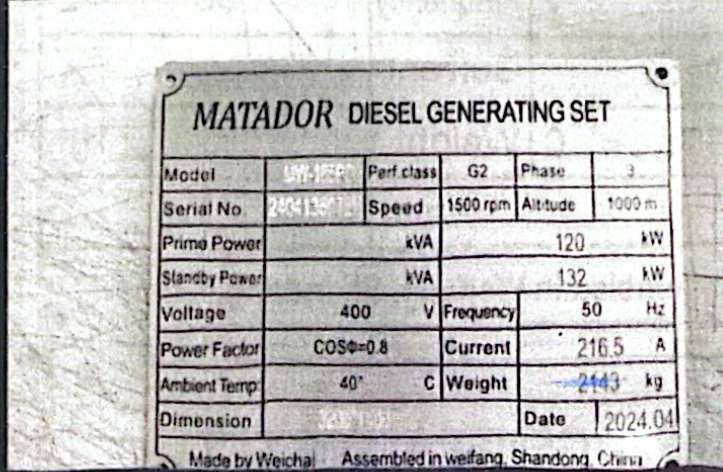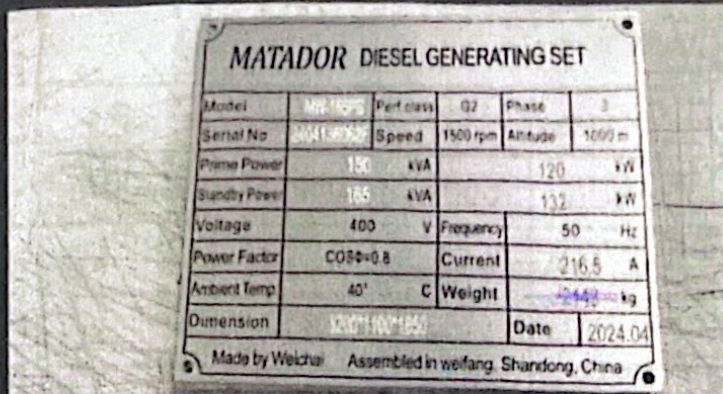

Weichai နောက်လရောက်မယ့် ထဲက

၁၁MW-165PS * 2U တွက်လဲ Name

Plate လေးလုပ်ပေးနော်

WEIGHT - 2070 KG ပြောင်းမယ်နော်

weifang ကို Weifang ပြောင်းပေးနော်

ကျန်တဲ့ Inforamtion က NP ထဲကတိုင်း

ဘဲနော်

Htat Chit Don Su



Message



Print Date : 20-Jan-2025

Taxi (Bus,Motorcycle,3-wheel etc...) Charges Form

No	Date	Holding Business	Department	Name	Rental Purpose	Departure Time	Start Location	End Location	Claim Amount	Allowed Amount	State	Remark
1	2025-01-10	Power Generator	Marketing & Sales Support	Htet Thu Zar	Machine Name Plate getting to Bo Son Pat Street(Downtown).	07:00	Bo Son Pat Street(Downtown)	Tharkayta(1) Zay	9,000	9,000	GA Manager Approved	